



The technician noticed that the cold nitrogen gas was discharging directly onto the DI water line also passing through the labyrinth.

Technician fashioned an extension for the vent line from Armaflex type insulation and connected it to the end of the line used for the vent. A photo of the modified vent line is shown in Fig. 2.



Fig. 2A: Vent line extension in Sector 20 after completion.

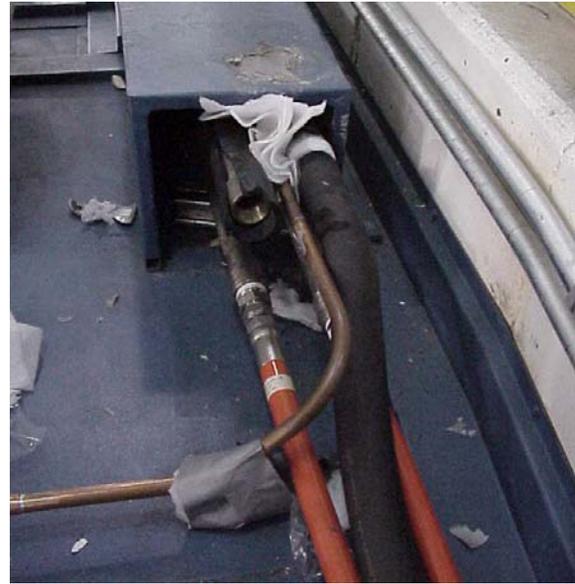


Fig. 2B: Close-up of vent line extension in Sector 20 (orange hoses are DI water lines)