Enclosures, EN-20102 and EN-20103, Digital ASCs for AHU-401 and AHU-403

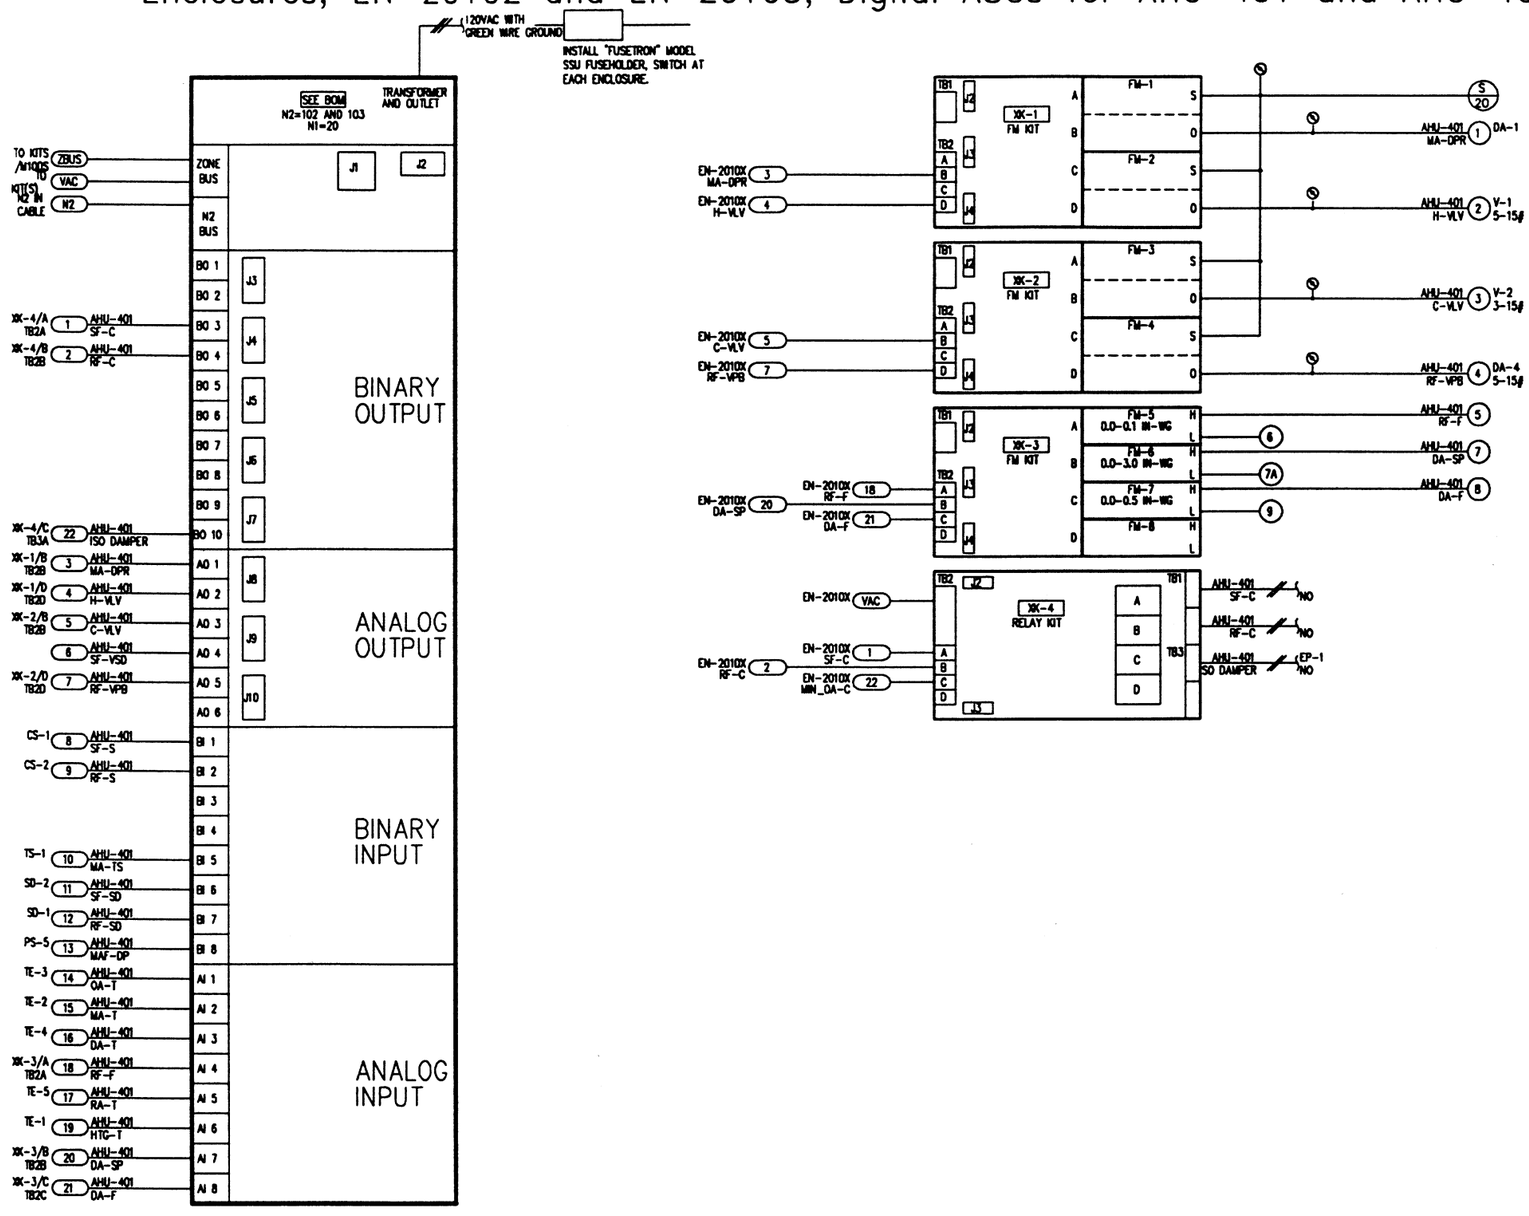

PANEL MATERIAL

	DEVICE TAG	QTY	CODE NUMBER	DESCRIPTION
(P)	FM-1-FM-4	8	FM-OAP102-0	OAP MANUAL MODULE
		8	FM-OAP103-0	E/P OUT FM FOR ASC
(P)	FM-5	2	FM-IDP001-0	DIFF PRESS INPUT FM .1 IN
		2	FM-PCN101-0	PNEU.CONN.MOD.
(P)	FM-6	2	FM-IDP030-0	DIFF PRESS INPUT FM 3. IN
		2	FM-PCN101-0	PNEU.CONN.MOD.
(P)	FM-7	2	FM-IDP005-0	DIFF PRESS INPUT FM .5 IN
		2	FM-PCN101-0	PNEU.CONN.MOD.
(P)	FM-8	2	FM-KIT127-0	FM BLANKOFFS
(P)	EN-20102	2	AS-AHU101-0	AIR HANDLING UNIT ENC/TER
	EN-20103	2	AS-AHU102-0	AIR HANDLING UNIT LOGIC B
		2	AS-XFR100-0	100VA TRANSFORMER KIT
		2	EN-ENC200-0	ENCLOSURE
(P)	XK-1-XK-3	6	AS-FMK100-0	FUNCTION MOD KIT-4 SLOTS
(P)	XK-4	2	AS-RLY100-0	LINE VOLTAGE RELAY KIT
	ACC	5	G-2010-5	0-30 PSI, 1 1/2 INCH PRESSURE GAUGE

NOTES:

1. ALL MATERIAL WITH (P) PRECEEDING THE DEVICE TAG IN THE BILL OF MATERIAL IS PROPRIETARY AND IS BEING SUPPLIED BY JOHNSON CONTROLS, INC. ALL OTHER MATERIAL IS NON-PROPRIETARY.

COPYRIGHT JOHNSON CONTROLS, INC.1993

FILE: EN-20102

DRAWING TITLE
Mixed Air Single Path VAV Air Handling Unit
Typical for AHU-401 & AHU-403
Enclosures, EN-20102, 20103

REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
		RECORD		06/06/94	SF

SALES ENGR	PROJECT MGR	APPL. ENGR	DRAWN	APPROVED
JP	SF	DCS	BY SF DATE 11/14/91	BY DATE

PROJECT
The Argonne National Labs
Advanced Photon Source Campus
9700 Cass Avenue South
Argonne, IL 60439

JOHNSON CONTROLS
Systems & Services Division

3007 MALMO ROAD
ARLINGTON HEIGHTS
ILLINOIS 60005
708/364-1500 Main
708/808-4438 Eng

CONTRACT NUMBER 91390-0009

DRAWING NUMBER 91-9-C-03B