Enclosure, EN-20108, Digital ASC for AHU-701

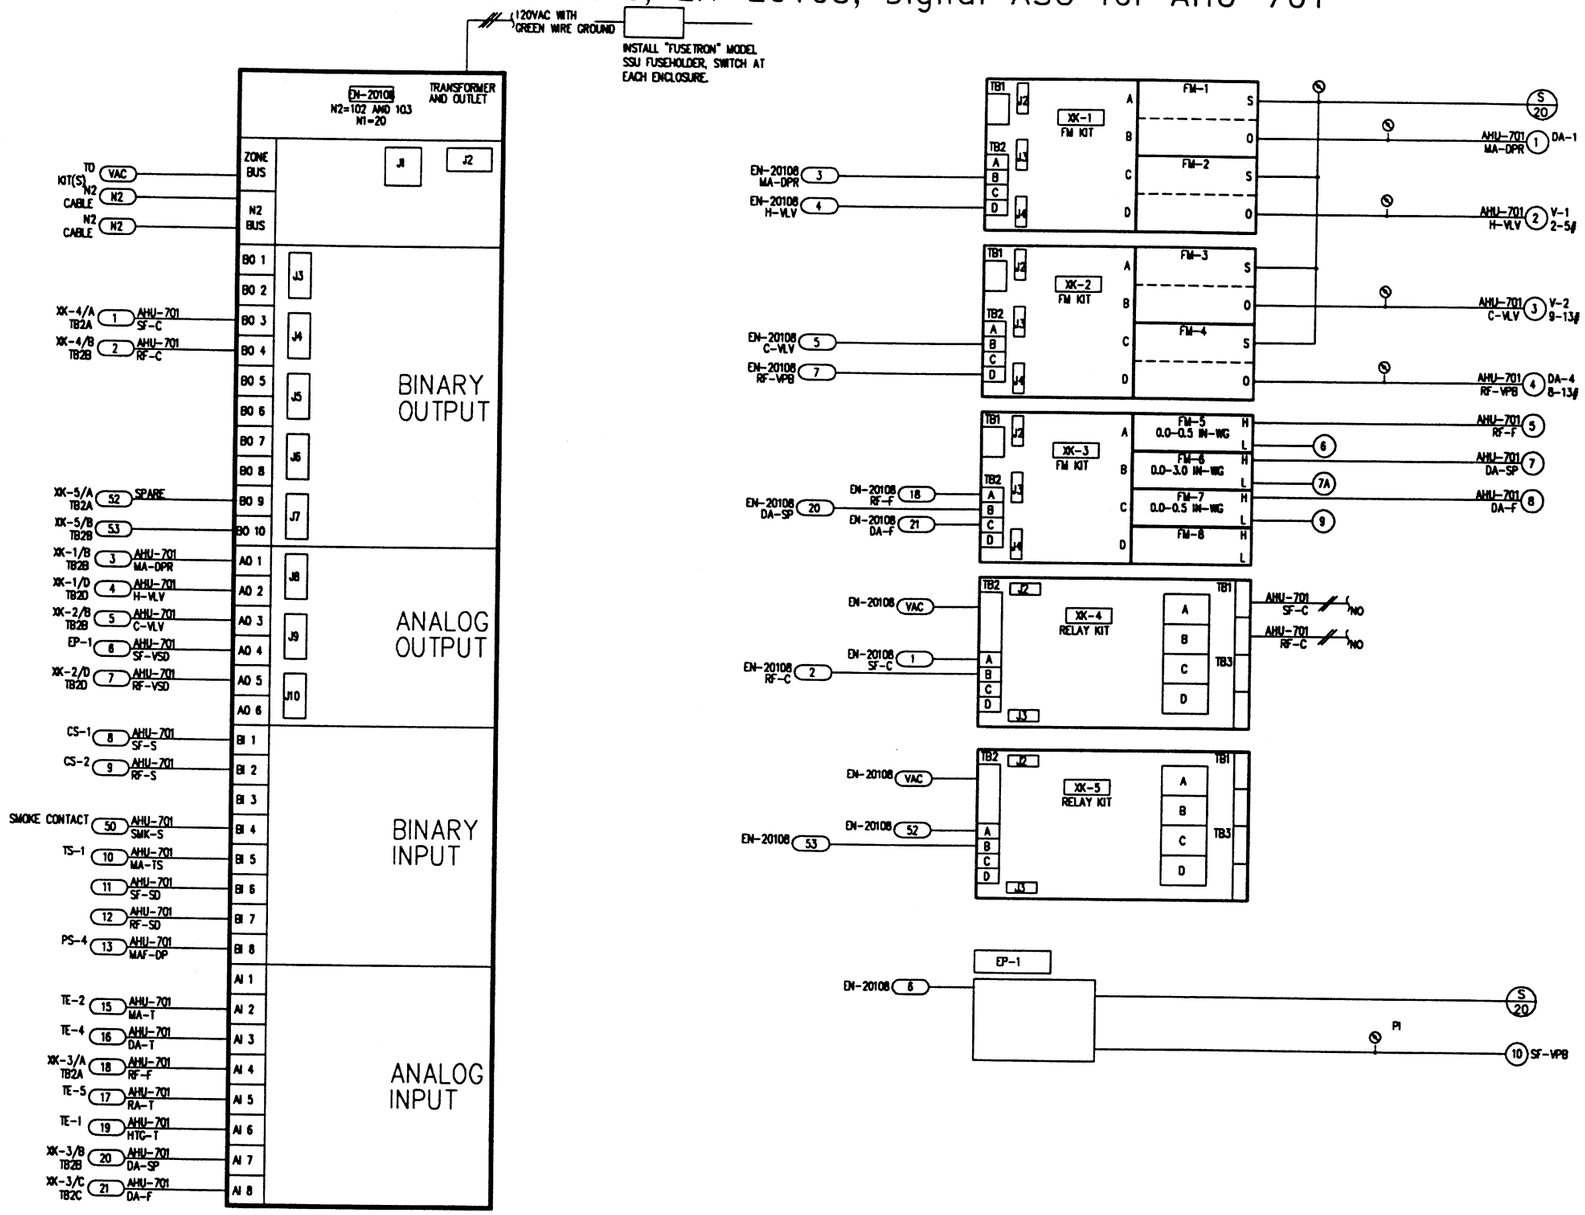

PANEL MATERIAL

	DEVICE TAG	QTY	CODE NUMBER	DESCRIPTION
(P)	EN-20108	1	AS-AHU101-0	AIR HANDLING UNIT ENC/TER
		1	AS-AHU102-0	AIR HANDLING UNIT LOGIC B
		1	AS-XFR100-0	100VA TRANSFORMER KIT
		1	EN-ENC200-0	ENCLOSURE
(P)	FM-1-FM-4	4	FM-DAP102-0	DAP MANUAL MODULE
		4	FM-DAP103-0	E/P OUT FM FOR ASC
(P)	FM-5	1	FM-IDP005-0	DIFF PRESS INPUT FM .5 IN
		1	FM-PCM101-0	PNEU.CONN.MOD.
(P)	FM-6	1	FM-IDP030-0	DIFF PRESS INPUT FM 3. IN
		1	FM-PCM101-0	PNEU.CONN.MOD.
(P)	FM-7	1	FM-IDP005-0	DIFF PRESS INPUT FM .5 IN
		1	FM-PCM101-0	PNEU.CONN.MOD.
(P)	FM-8	1	FM-KIT127-0	FM BLANKOFFS
(P)	XK-1-XK-3	3	AS-FMK100-0	FUNCTION MOD KIT-4 SLOTS
(P)	XK-4-XK-5	2	AS-RLY100-0	LINE VOLTAGE RELAY KIT
(P)	EP-1	1	EP-8080-4	E/P TRANSDUCER
	ACC	6	G-2010-5	0-30 PSI, 1 1/2 INCH PRESSURE GAUGE

NOTES:

1. ALL MATERIAL WITH (P) PRECEEDING THE DEVICE TAG IN THE BILL OF MATERIAL IS PROPRIETARY AND IS BEING SUPPLIED BY JOHNSON CONTROLS, INC. ALL OTHER MATERIAL IS NON-PROPRIETARY.

COPYRIGHT JOHNSON CONTROLS, INC.1993

DRAWING TITLE
Enclosure, EN-20108
Air Handling Unit, AHU-701
Control Hardware: AS-AHU100

PROJECT
The Argonne National Labs
Advanced Photon Source Campus
9700 Cass Avenue South
Argonne, IL 60439

REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
		RECORD		06/08/94	SF
	3	CC REVISION	6	03/30/93	SF

SALES ENGR	PROJECT MGR	APPL. ENGR	DRAWN			APPROVED	
JP	SF	DCS	BY SF	DATE 12/09/91	BY	DATE	

FILE:
DCODE:

JOHNSON CONTROLS
Systems & Services Division

3007 MALMO ROAD
ARLINGTON HEIGHTS
ILLINOIS 60005
708/364-1500 Main
708/808-4438 Eng

CONTRACT NUMBER 91390-0009

DRAWING NUMBER 91-9-C-05B