Enclosure, EN-20109, Digital ASC for Air Handling Unit, AHU-702

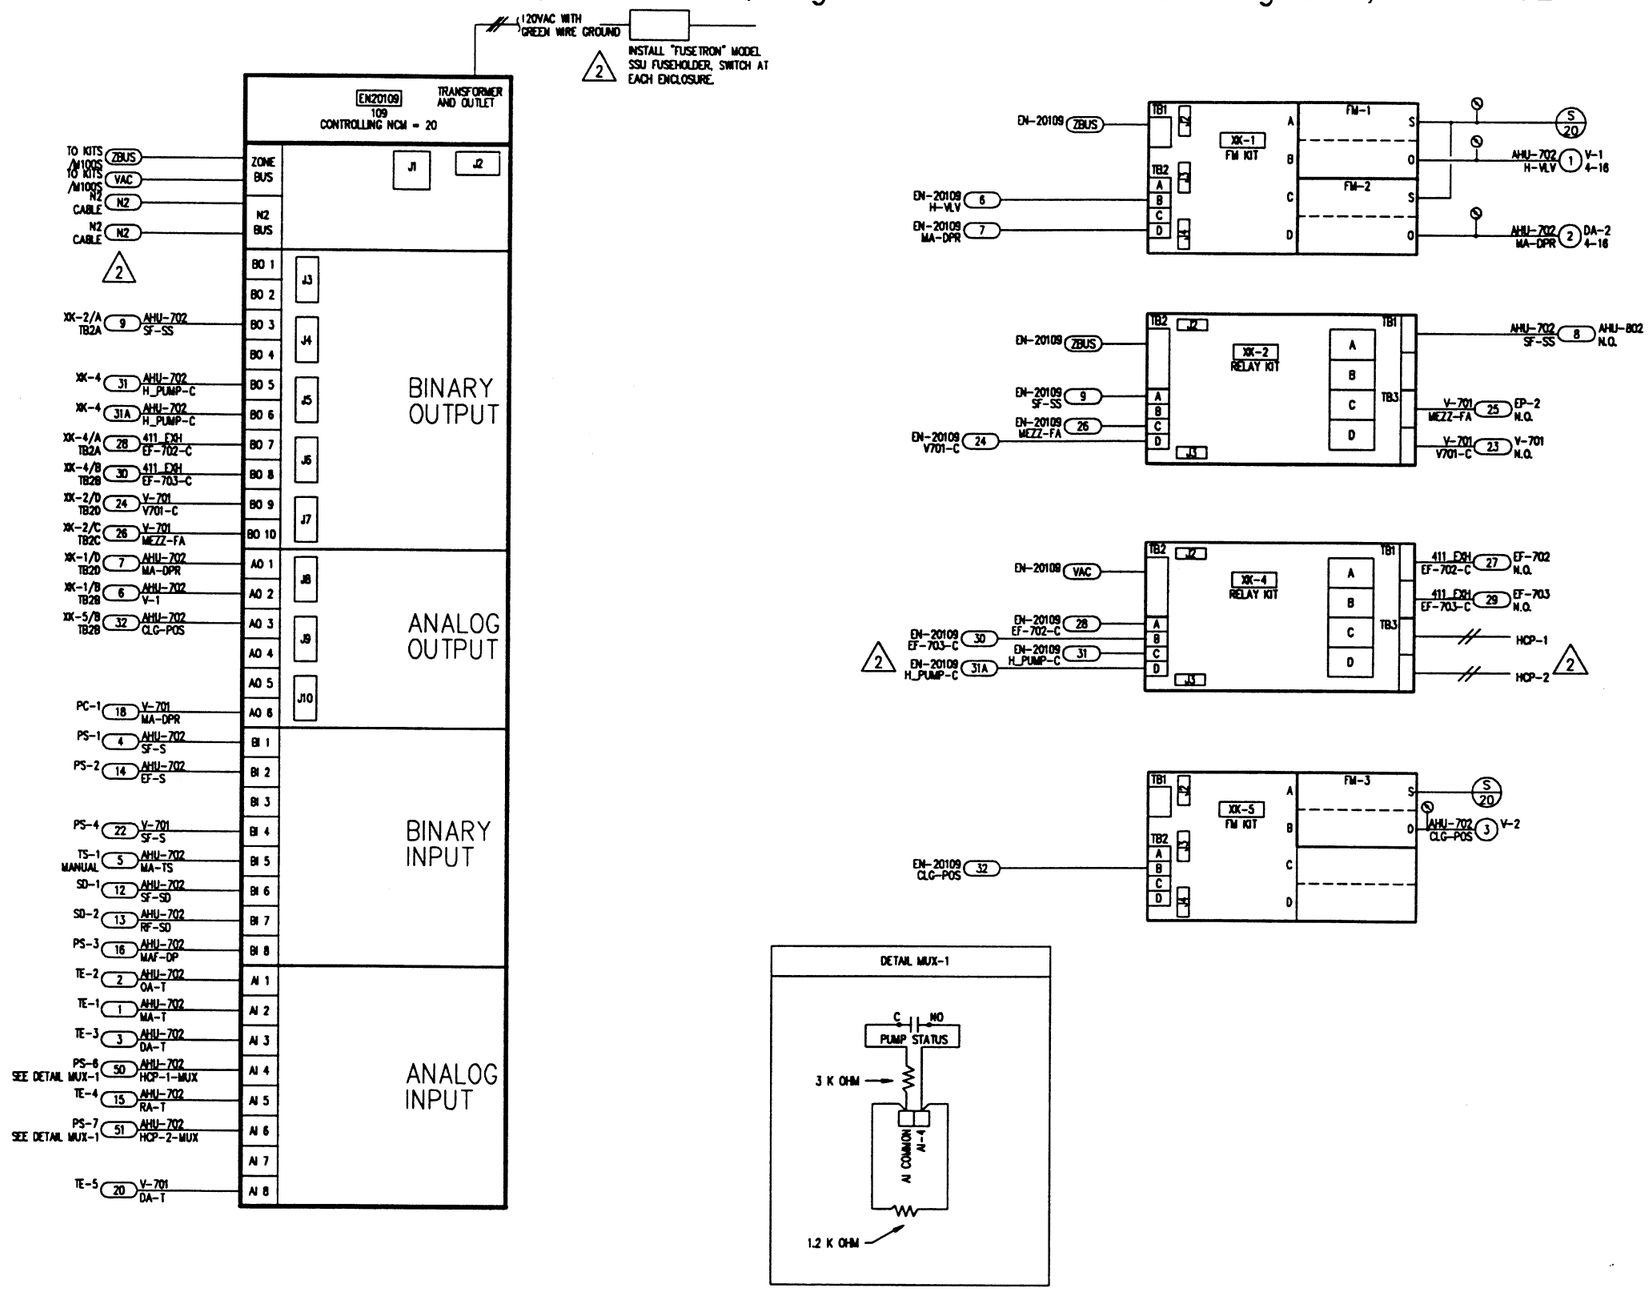

PANEL MATERIAL

DEVICE TAG	QTY	CODE NUMBER	DESCRIPTION
(P) EN20109	1	AS-AHU101-0	AIR HANDLING UNIT ENC/TER
	1	AS-AHU102-0	AIR HANDLING UNIT LOGIC B
	1	EN-ENC200-0	ENCLOSURE
	1	AS-XFR100-0	100VA TRANSFORMER KIT
(P) FM-1-FM-3	3	FM-DAP102-0	DAP MANUAL MODULE
	3	FM-DAP103-0	E/P OUT FM FOR ASC
(P) XK-1,XK-5	1	AS-FMK100-0	FUNCTION MOD KIT-4 SLOTS
(P) XK-2,XK-4	2	AS-RLY100-0	LINE VOLTAGE RELAY KIT
(P) ACC	4	G-2018-5	0-30 PSI, 1 1/2 INCH PRESSURE GAUGE

NOTES:

1. ALL MATERIAL WITH (P) PRECEEDING THE DEVICE TAG IN THE BILL OF MATERIAL IS PROPRIETARY & IS BEING SUPPLIED BY JOHNSON CONTROLS, INC. ALL OTHER MATERIAL IS NON-PROPRIETARY.

COPYRIGHT JOHNSON CONTROLS, INC.1991

FILE: EN-20109

DRAWING TITLE
Enclosure, EN-20109
Air Handling Unit, AHU-702
Controller Hardware: AS-AHU100

REFERENCE DRAWING	NO.	REVISION-LOCATION	ECN	DATE	BY
	2	GENERAL		07/11/92	SF
	1	GENERAL		05/01/92	SF

SALES ENGR	PROJECT MGR	APPL. ENGR	DRAWN		APPROVED	
DB	SP	SF	BY SF	DATE 12/12/91	BY	DATE

PROJECT
The Argonne National Labs
Advanced Photon Source Campus
9700 Cass Avenue South
Argonne, IL 60439

JOHNSON CONTROLS
Systems & Services Division

3007 MALMO ROAD
ARLINGTON HEIGHTS
ILLINOIS 60005
708/364-1500 Main
708/808-4438 Eng

CONTRACT NUMBER 91390-0009

DRAWING NUMBER 91-9-C-06B