Enclosure, EN-1010X, Digital ASCS for HV-102, 103

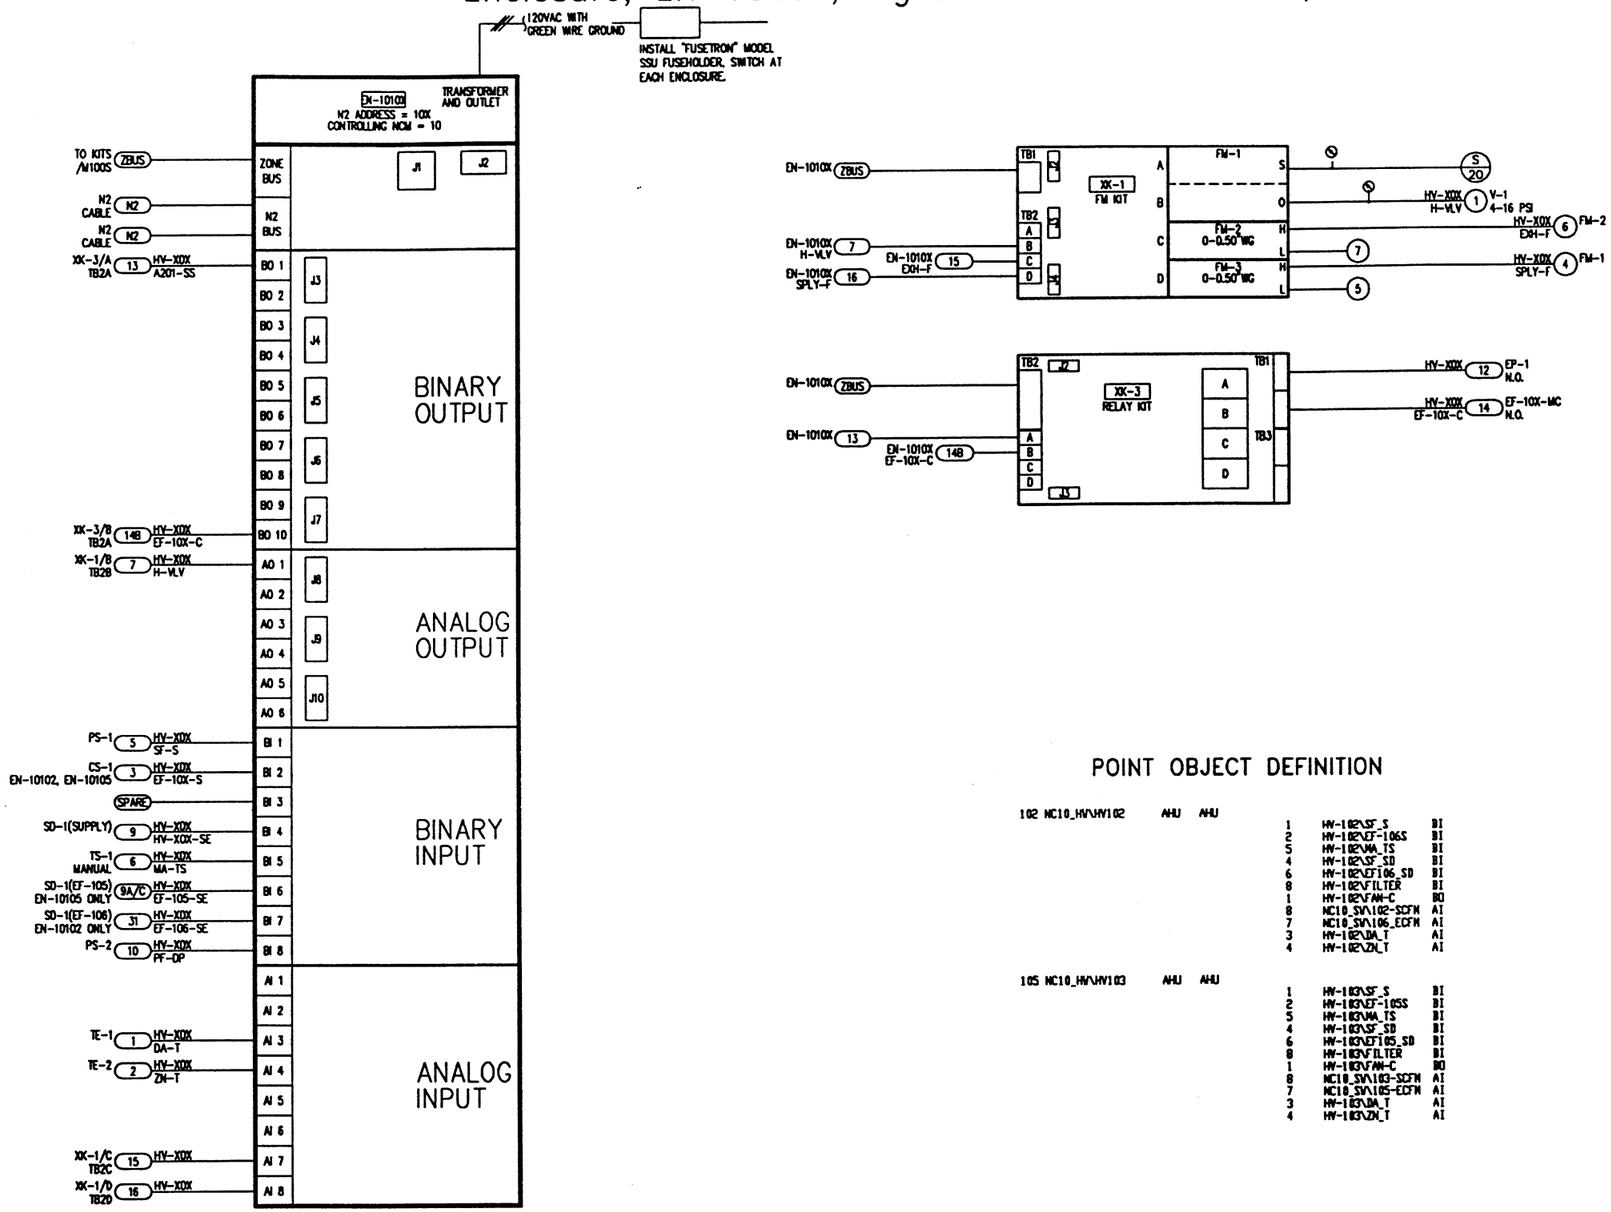

POINT OBJECT DEFINITION

102 NC10_HV\HV102	AHU	AHU			
			1	HV-102\SF_S	BI
			2	HV-102\EF-106S	BI
			5	HV-102\MA_TS	BI
			4	HV-102\SF_SD	BI
			6	HV-102\EF106_SD	BI
			8	HV-102\FILTER	BI
			1	HV-102\FAN-C	BO
			8	NC10_SV\102-SCFM	AI
			7	NC10_SV\106_ECFM	AI
			3	HV-102\DA_T	AI
			4	HV-102\ZN_T	AI
105 NC10_HV\HV103	AHU	AHU			
			1	HV-103\SF_S	BI
			2	HV-103\EF-105S	BI
			5	HV-103\MA_TS	BI
			4	HV-103\SF_SD	BI
			6	HV-103\EF105_SD	BI
			8	HV-103\FILTER	BI
			1	HV-103\FAN-C	BO
			8	NC10_SV\103-SCFM	AI
			7	NC10_SV\105-ECFM	AI
			3	HV-103\DA_T	AI
			4	HV-103\ZN_T	AI

PANEL MATERIAL

	DEVICE TAG	QTY	CODE NUMBER	DESCRIPTION
(P)	EN-1010X	2	AS-AHU101-0	AIR HANDLING UNIT ENC/TCR
		2	AS-AHU102-0	AIR HANDLING UNIT LOGIC B
		2	AS-XFR100-0	100VA TRANSFORMER KIT
		2	EN-ENC200-0	ENCLOSURE
(P)	FM-1	2	FM-DAP102-0	DAP MANUAL MODULE
		2	FM-DAP103-0	E/P OUT FM FOR ASC
(P)	FM-2-FM-3	4	FM-IDP050-0	1/2 IN WG DIFF PRESS TRANSMITTER FM
(P)	XK-1	2	AS-FMK100-0	FUNCTION MOD KIT-4 SLOTS
(P)	XK-3	2	AS-RLY100-0	LINE VOLTAGE RELAY KIT
(P)	ACC	4	G-2010-5	0-30 PSI, 3 1/2 INCH PRESSURE GAUGE

NOTES:

1. ALL MATERIAL WITH (P) PRECEEDING THE DEVICE TAG IN THE BILL OF MATERIAL IS PROPRIETARY AND IS BEING SUPPLIED BY JOHNSON CONTROLS, INC. ALL OTHER MATERIAL IS NON-PROPRIETARY.

COPYRIGHT JOHNSON CONTROLS, INC.1993

FILE: EN-10104

DRAWING TITLE
Enclosure, EN-10104
Digital ASC, AHU100 Serving
Heating/Ventilating Units,
HV-102, 103 and 301

NO.	REVISION-LOCATION	ECN	DATE	BY
	RECORD		05/11/94	SF
4	ADD ICS ALMS		11/10/92	SF
3	GENERAL		08/24/92	SF

REFERENCE DRAWING			
SALES ENGR	PROJECT MGR	APPL. ENGR	
JP	SF	DCS	

DRAWN BY SF DATE 12/02/91
APPROVED BY DATE

PROJECT
The Argonne National Labs
Advanced Photon Source Campus
9700 Cass Avenue South
Argonne, IL 60439

JOHNSON CONTROLS
Systems & Services Division

3007 MALMO ROAD
ARLINGTON HEIGHTS
ILLINOIS 60005
708/364-1500 Main
708/806-4438 Eng

CONTRACT NUMBER 91390-0009

DRAWING NUMBER 91-9-B-03B