FIELD MATERIAL

DEVICE TAG	QTY	CODE NUMBER	DESCRIPTION
AF-1	1	A-4000-141	FILTER STATION; REDUCING
TS-1-TS-2	10	T26A-14C	LINE VOLTAGE THERMOSTAT

UNIT HEATERS

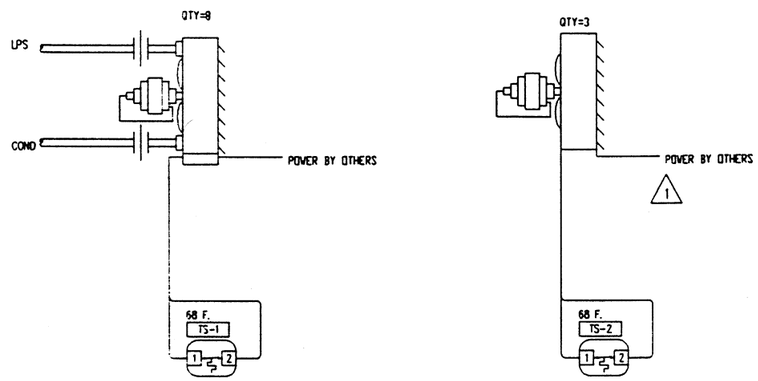

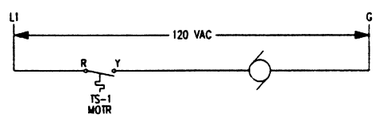

STEAM UNIT HEATERS

WALL MOUNTED TEMPERATURE SWITCH, TS-1 WILL CYCLE UNIT HEATER FAN TO MAINTAIN A SPACE TEMPERATURE SETPOINT OF 68 F.(ADJUSTABLE)

ELECTRIC UNIT HEATERS

WALL MOUNTED TEMPERATURE SWITCH WILL CYCLE UNIT HEATER CONTROLS TO MAINTAIN THE CONTROL SETPOINT.

PNEUMATIC POWER

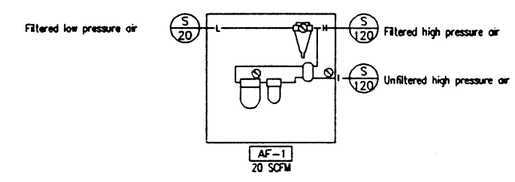

COPYRIGHT JOHNSON CONTROLS, INC.1993

FILE: 450_UH

NO.	REVISION-LOCATION	ECN	DATE	BY
	RECORD		05/11/94	SF
2	GENERAL		09/09/92	SF
1	GENERAL		06/30/91	SF

REFERENCE DRAWING

DRAWING TITLE
Building 450
Unit Heaters

Pneumatic Power Supply

SALES ENGR	PROJECT MGR	APPL. ENGR	DRAWN			APPROVED	
JP	SF	DCS	BY SF	DATE 01/15/92	BY	DATE	

PROJECT
The Argonne National Labs
Advanced Photon Source Campus
9700 Cass Avenue South
Argonne, IL 60439

JOHNSON CONTROLS
Systems & Services Division

3007 MALMO ROAD
ARLINGTON HEIGHTS
ILLINOIS 60005
708/364-1500 Main
708/806-4438 Eng

CONTRACT NUMBER
91390-0009

DRAWING NUMBER
91-9-A-08A