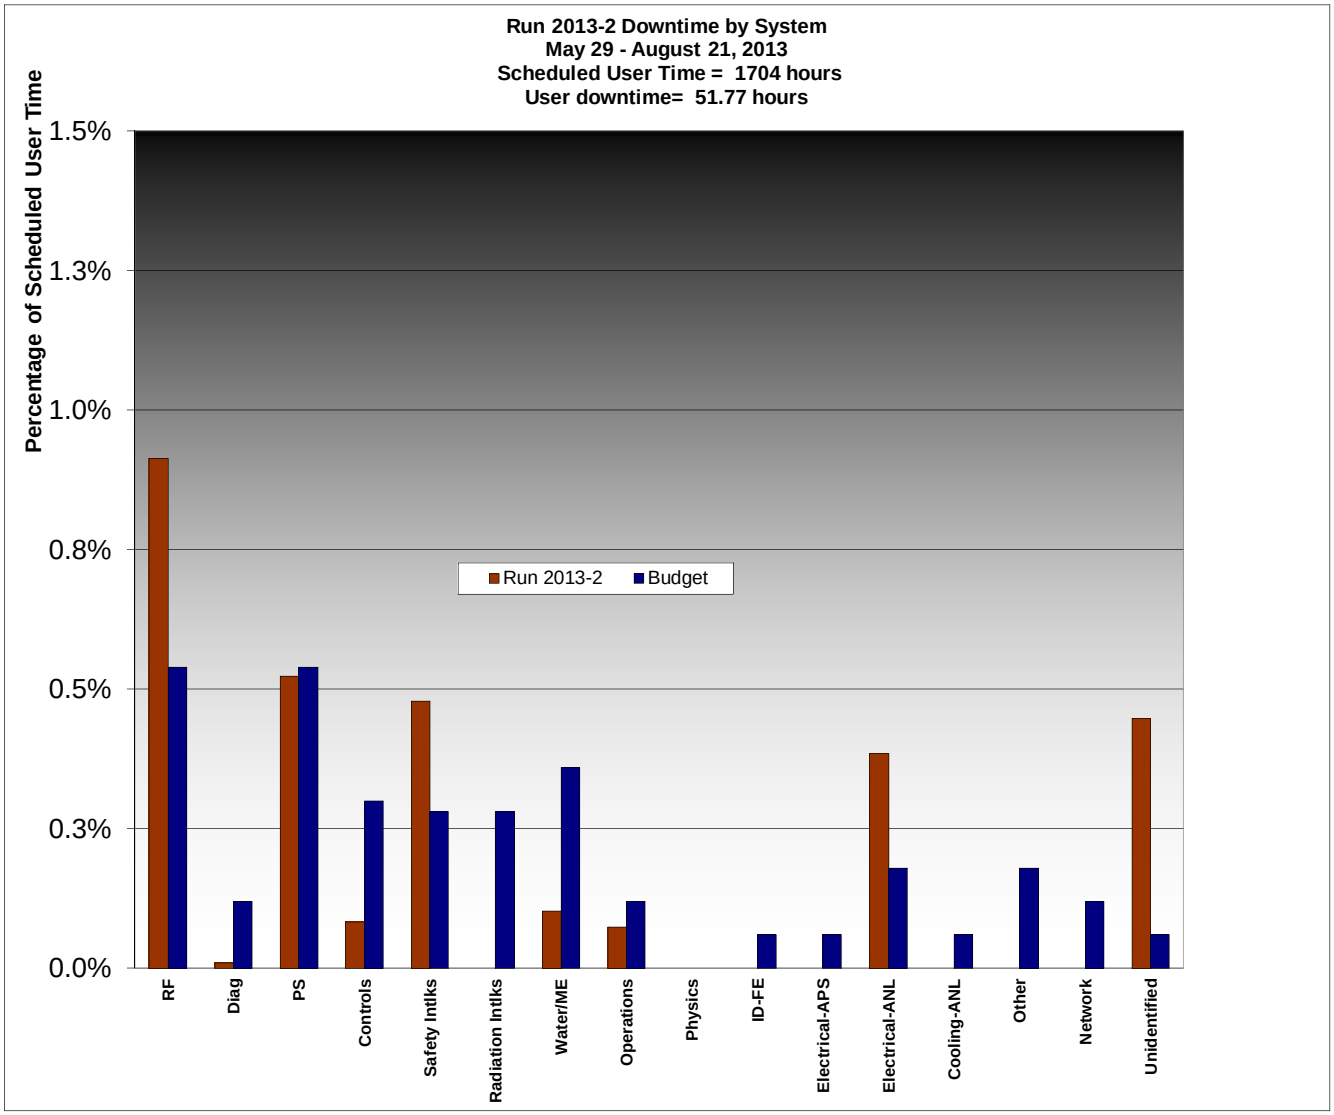
Run 2013-2 Downtime by System
May 29 - August 21, 2013
Scheduled User Time = 1704 hours
User downtime= 51.77 hours
Percentage of Scheduled User Time
1.5%
1.3%
1.0%
0.8%
0.5%
0.3%
0.0%
Run 2013-2
Budget
RF
Diag
PS
Controls
Safety Intlks
Radiation Intlks
Water/ME
Operations
Physics
ID-FE
Electrical-APS
Electrical-ANL
Cooling-ANL
Other
Network
Unidentified